


NOTE: SLUICE GATE (00577) CONNECTING RESERVOIRS NOT SHOWN

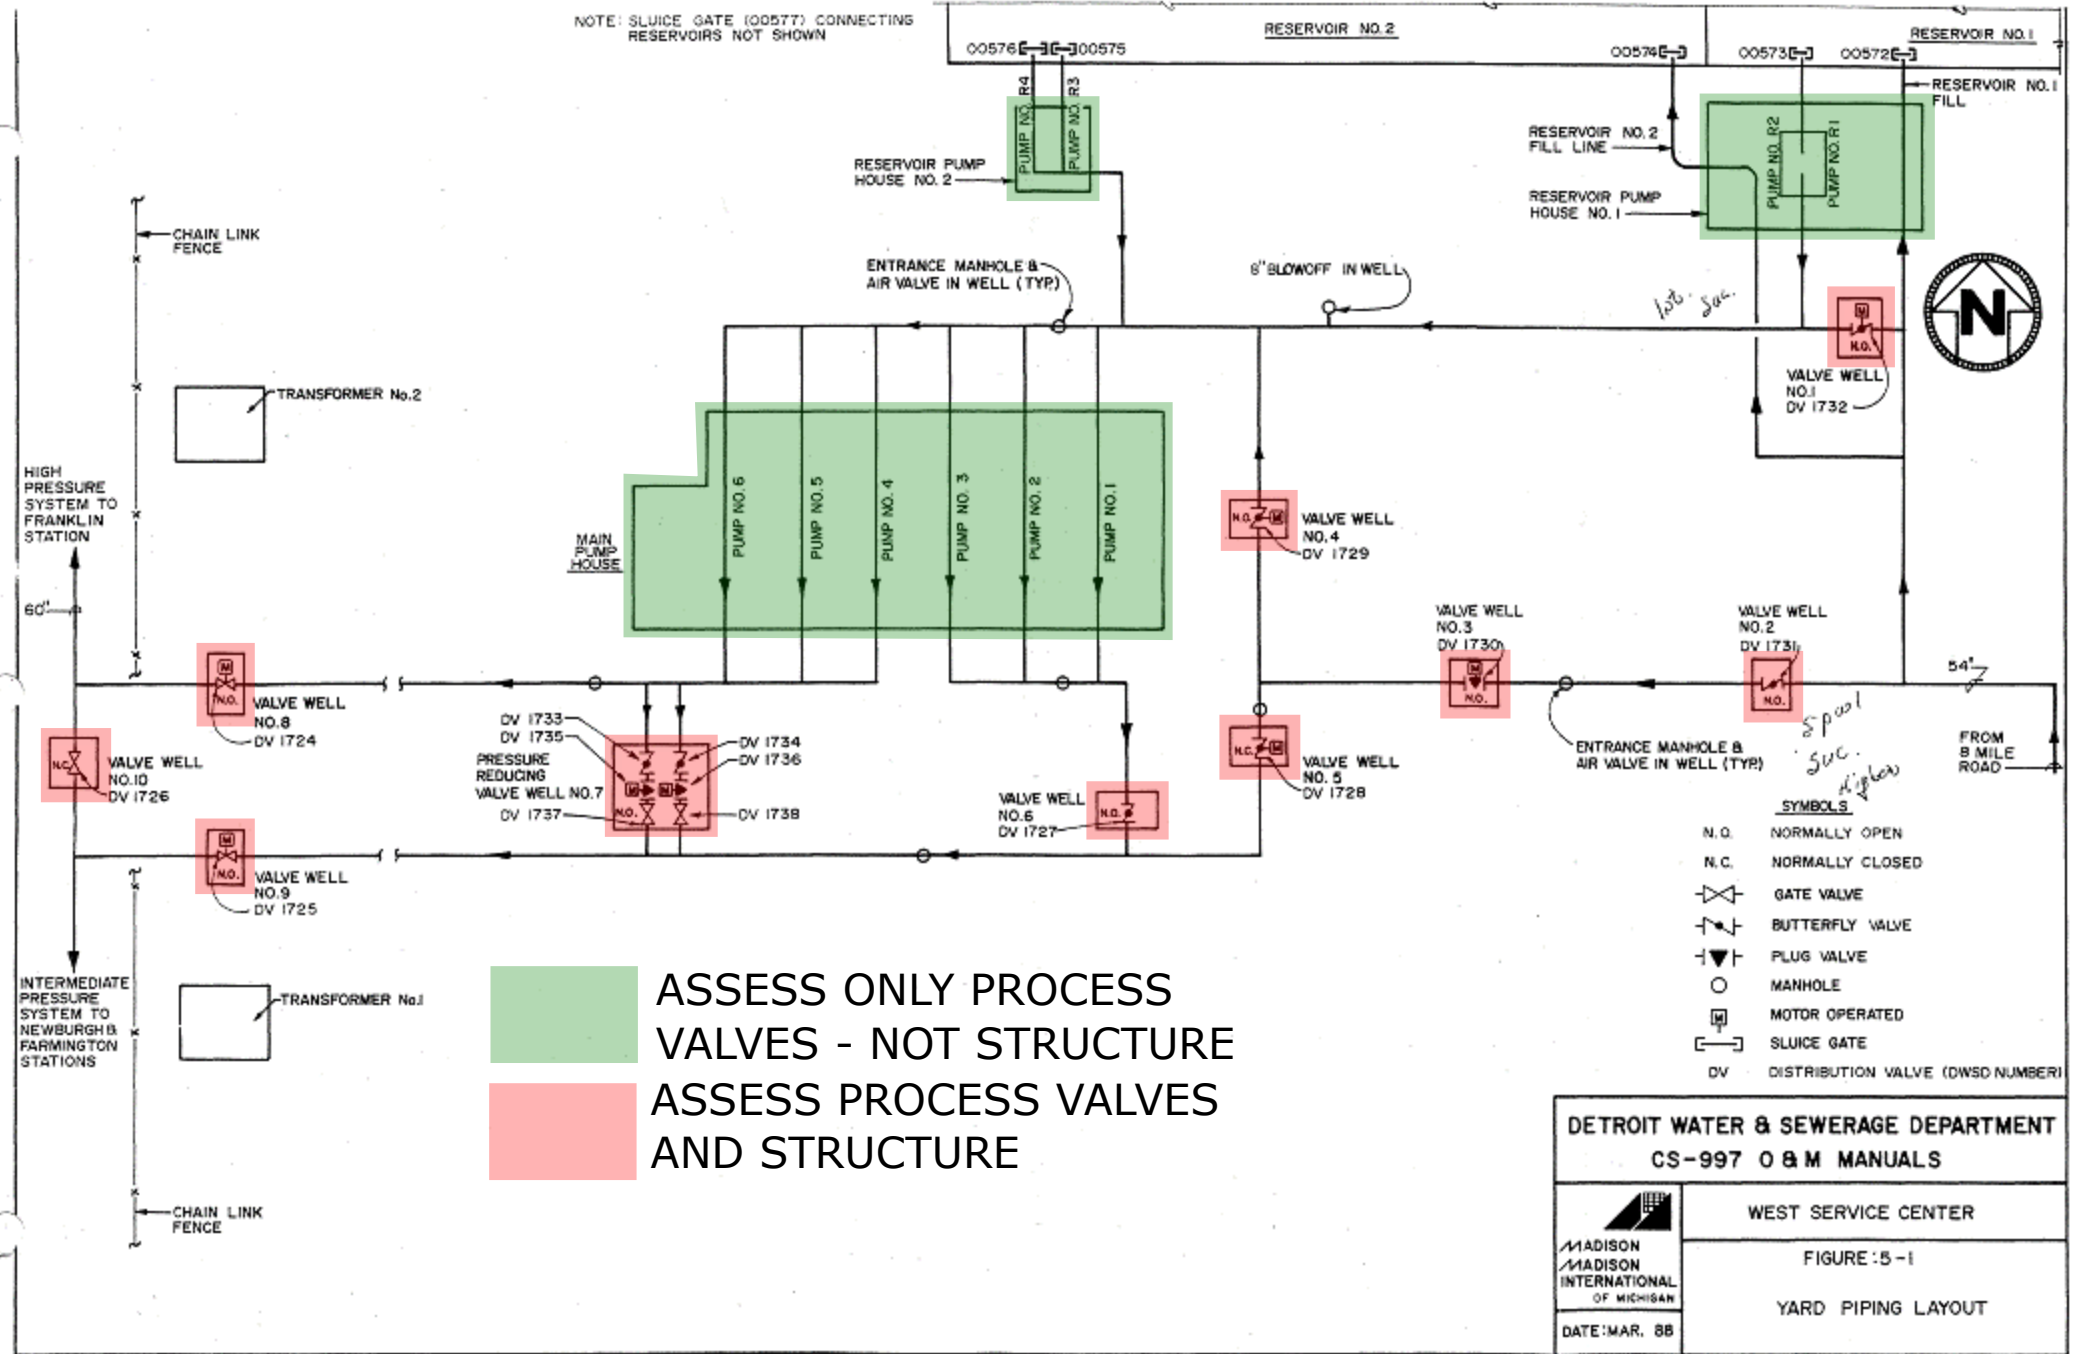

ASSESS ONLY PROCESS VALVES - NOT STRUCTURE  
 ASSESS PROCESS VALVES AND STRUCTURE

- SYMBOLS**
- N.O. NORMALLY OPEN
  - N.C. NORMALLY CLOSED
  - GATE VALVE
  - BUTTERFLY VALVE
  - PLUG VALVE
  - MANHOLE
  - MOTOR OPERATED
  - SLUICE GATE
  - DV DISTRIBUTION VALVE (DWS NUMBER)

**DETROIT WATER & SEWERAGE DEPARTMENT**  
CS-997 O & M MANUALS

---

WEST SERVICE CENTER

---

FIGURE 5-1

---

YARD PIPING LAYOUT

MADISON  
INTERNATIONAL  
OF MICHIGAN

DATE: MAR. 88